




JUGOTERM
Merošina

**ČELIČNI
PANELNI RADIJATORI**

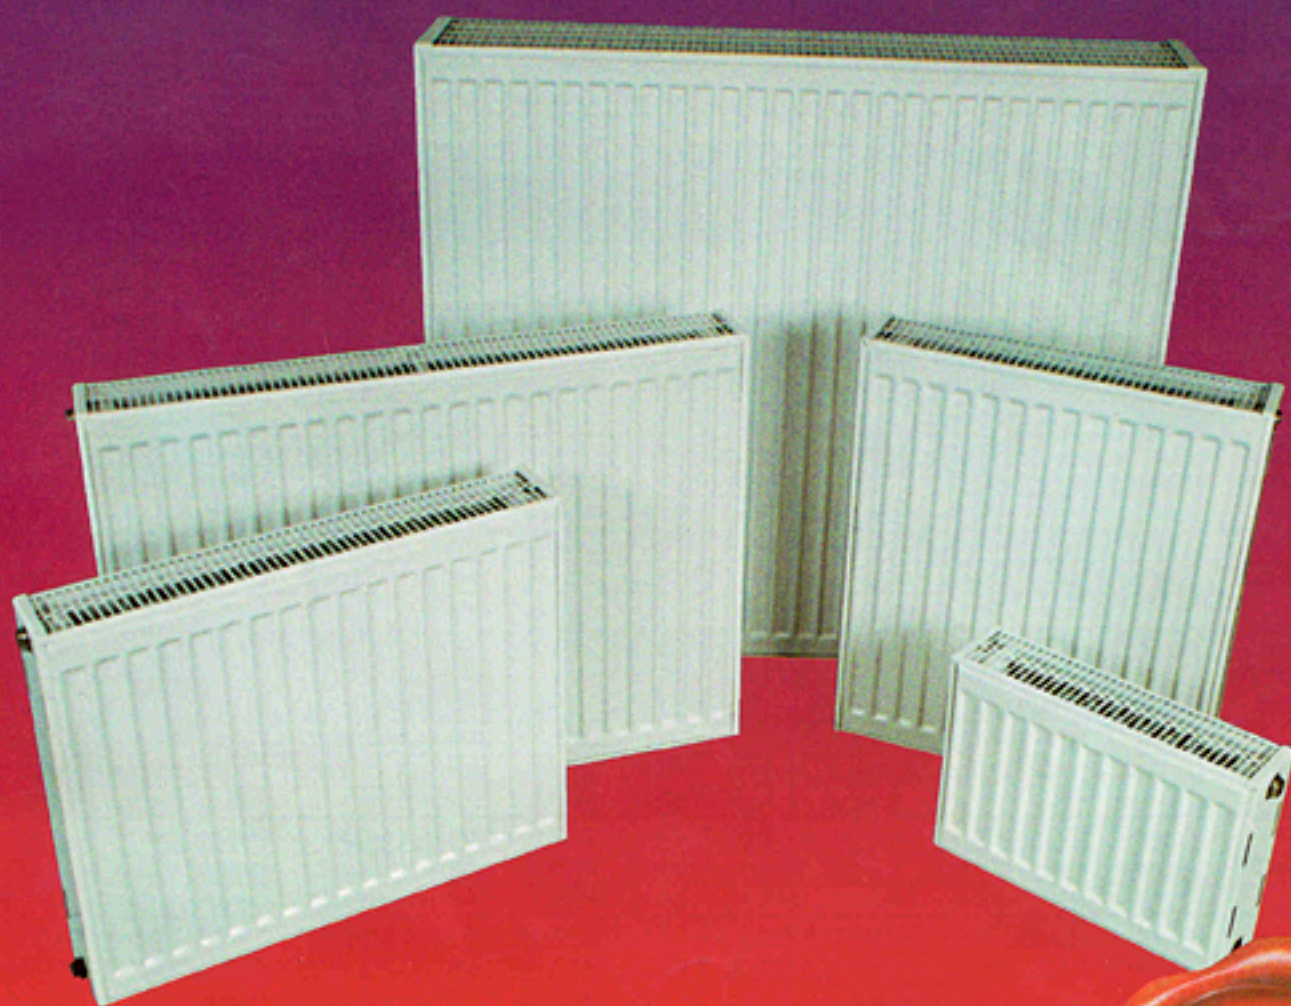

Garancija
15
godina

TEHNIČKE KARAKTERISTIKE:

- Materijal: dekapirani čelični lim debljine 1,25 mm
 - Površinska obrada: fosfatiranje, grundiranje, elektrostatsko lakiranje - pečenje na temperaturi od 180°C

- Boja: **bela RAL 9010**

- Radni pritisak: **0,6 MPa = 6 bar**

- Probni pritisak: **0,9 MPa = 9 bar**

- Max. radna temperatura: **110°C**

DIMENZIJE:


visine: **300; 500; 600; 900**

dužine: **500 + 3000 mm**

debljina: **100 mm**

priključci: **R 1/2"**

DIJAGRAM PADA PRITISKA Δp (Pa)

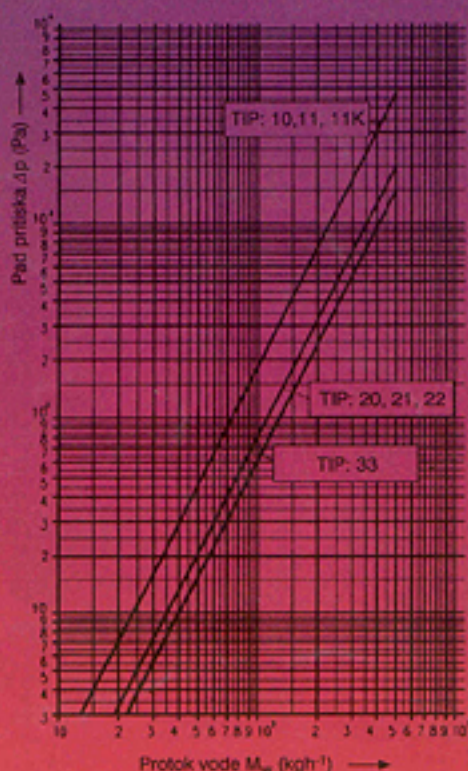

OBRAČUNSKI FAKTOR f ZA RAZLIČITE TEMPERATURE

Temperatura ulazne vode	Temperatura izlazne vode	Faktor f u zavisnosti od sobne temperature t_s (°C) (prema eksponentu $m = 1,3$)					
		12	15	18	20	22	24
90	85	0.73	0.77	0.82	0.85	0.88	0.92
	80	0.77	0.81	0.88	0.89	0.93	0.97
	75	0.81	0.85	0.90	0.94	0.98	1.03
	70	0.85	0.90	0.98	1.00	1.05	1.10
	65	0.90	0.95	1.02	1.07	1.12	1.17
	60	0.95	1.02	1.09	1.14	1.20	1.27
85	80	0.80	0.85	0.90	0.94	0.98	1.02
	75	0.84	0.89	0.95	0.99	1.04	1.08
	70	0.89	0.94	1.01	1.05	1.10	1.16
	65	0.94	1.00	1.07	1.12	1.18	1.24
80	75	0.88	0.94	1.00	1.05	1.10	1.15
	70	0.93	0.99	1.06	1.11	1.17	1.22
	65	0.98	1.05	1.13	1.19	1.25	1.32
	60	1.05	1.12	1.21	1.27	1.35	1.42
75	70	0.96	1.05	1.12	1.18	1.24	1.30
	65	1.04	1.11	1.19	1.26	1.33	1.40
	60	1.10	1.19	1.28	1.35	1.43	1.52
	55	1.18	1.27	1.38	1.47	1.56	1.66
	50	1.25	1.35	1.47	1.57	1.67	1.79
70	65	1.09	1.18	1.27	1.34	1.42	1.50
	60	1.17	1.26	1.36	1.44	1.53	1.63
	55	1.25	1.35	1.47	1.57	1.67	1.79
	50	1.35	1.47	1.61	1.72	1.85	1.99
65	60	1.24	1.34	1.46	1.56	1.66	1.77
	55	1.33	1.44	1.58	1.68	1.80	1.94
	50	1.43	1.57	1.73	1.85	1.99	2.15
	45	1.56	1.72	1.91	2.07	2.24	2.44
	40	1.72	1.91	2.14	2.34	2.56	2.82
60	55	1.42	1.55	1.70	1.82	1.96	2.11
	50	1.53	1.68	1.87	2.02	2.18	2.36
	45	1.67	1.85	2.07	2.24	2.45	2.68
	40	1.85	2.07	2.34	2.56	2.82	3.14
55	50	1.65	1.82	2.03	2.20	2.39	2.61
	45	1.80	2.01	2.25	2.46	2.69	2.98
	40	1.99	2.24	2.56	2.82	3.12	3.50
	35	2.24	2.56	2.97	3.32	3.76	4.32
	30	2.56	2.97	3.50	3.96	4.50	5.14
50	45	1.96	2.20	2.49	2.73	3.02	3.36
	40	2.17	2.46	2.83	3.14	3.51	3.97
	35	2.45	2.82	3.30	3.72	4.24	4.94
55	40	2.39	2.73	3.18	3.55	4.02	4.60
	35	2.70	3.14	3.72	4.24	4.89	5.76

Izračunavanje količine toplote se vrši obrascem:

$$Q_N = Q_C / f$$

gde je:

Q_N - količina toplote za različite temperature

Q_C - količina toplote za 90/70°C

f - obračunski faktor ($m = 1,3$)



JUGOTERM

**Fabrika radijatora i
 klima uređaja**

Merošina
 Mramorsko brdo bb
 018/694-054, 694-550
 694-551, 694-552
 694-328, 694-332

PREDSTAVNIŠTVA

Beograd: Ul. G. Principa 1; tel/fax 011-2633-370, 011-2184-705

Novi Sad: Ul. M. Dimitrijevića 65 tel. 021-541-530

Niš: Ul. Jovana Ristića 10; tel/fax. 018-511-523

Podgorica: Ul. Moše Pijade 28; tel/fax. 081-611-229

Skoplje: Ul. Belasica bb. Skopski sajam; tel/fax. 091-222-623